




1.

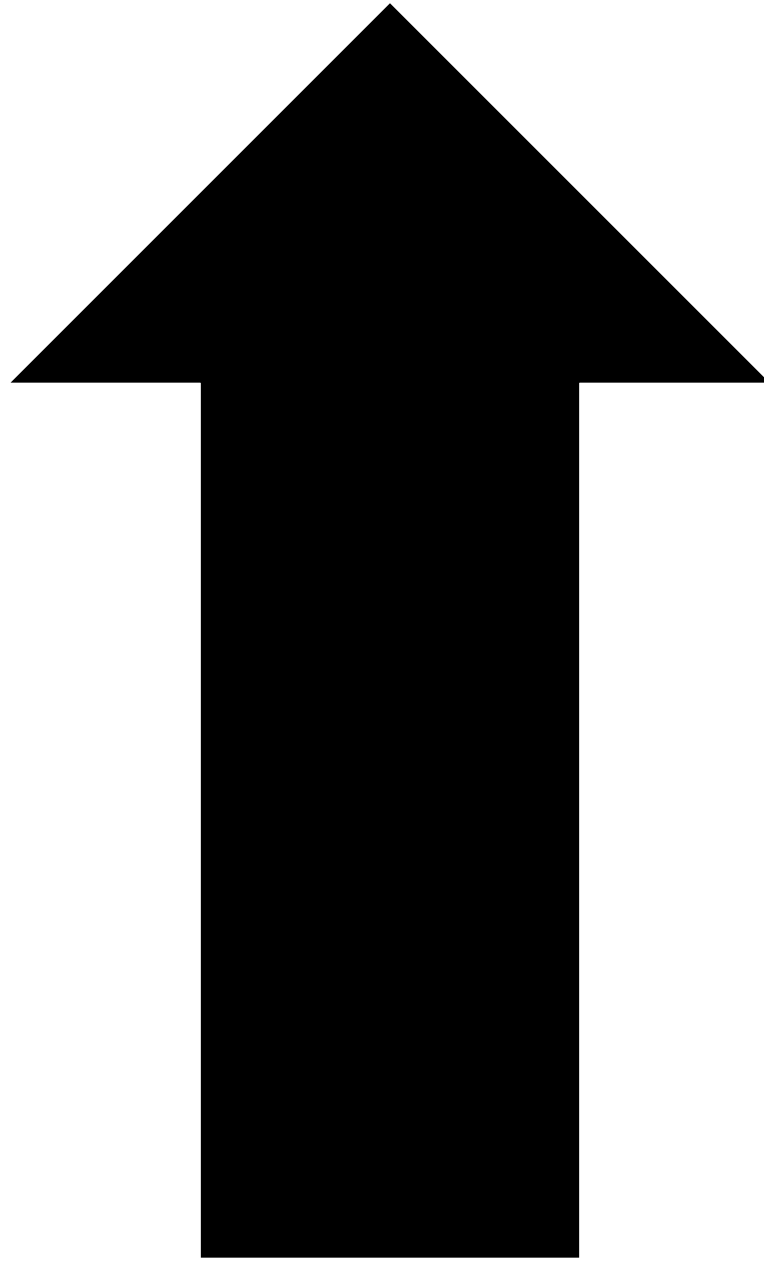

↑ 2.

ENERGIZED

4" FRESH

WATER LINE



3.

4" SHUT OFF
VALVE IN OFF
POSITION

↑ 4.

B/O STATION

&

CLOCK

**FIRE
HOSE**

BRA TTICE
CLOTH

↑ 7.

TEMPORARY STOPPING

↑ 8.

START OFF

SMOKE

SMOKE

END OF

4 % CH₄

250 PPM CO

18 % O₂

UNDERCAST

10.



4 % CH₄

250 PPM CO

18 % O₂



FIRE

NOZZLE

TURNED OFF



CAVED
AIRTIGHT



CAVED

AIRTIGHT

15. ↑



START OFF

SMOKE

SMOKE

END OF



**UNSAFE
ROOF**



UNDERCAST WALL

LIVE

UNCONSCIOUS


**UNSAFE
ROOF**

UNDRICAST WALL

**UNSAFE
ROOF**

BODY

**SCOOP
ON FIRE**

25. 

R/A

START OFF

SMOKE

SMOKE

END OF



DOOR
OPEN

PURGE

VALVE

CLOSED

**DOOR
CLOSED**

LIVE

UNCONSCIOUS


CAVED

AIRTIGHT

CAVED

AIRTIGHT

33. ↑

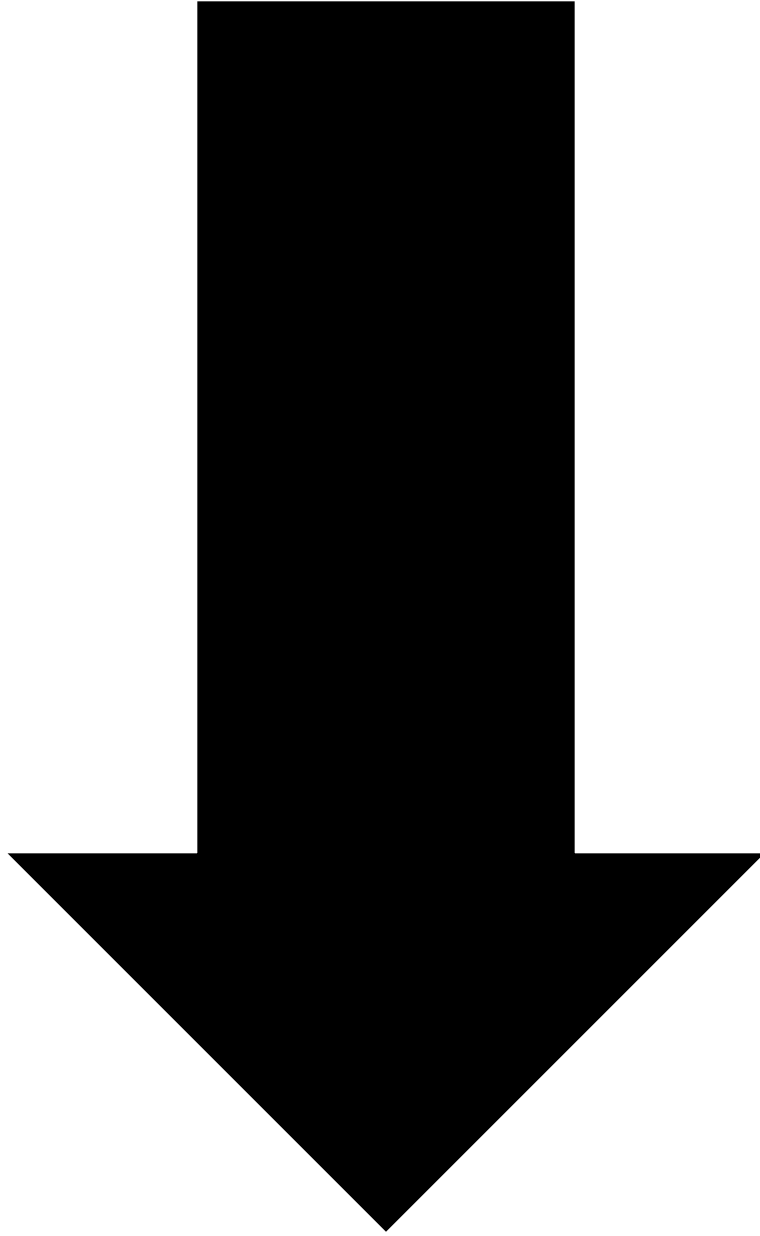

START OFF

SMOKE

SMOKE

END OF

**UNSAFE
ROOF**

